


TR Multi-Unit Configuration Options

TR PARALLEL CONFIGURATION

IMPORTANT: All units MUST have the same electrical configuration and temperature settings in a parallel scenario. Pipe lengths from cold water inlets and hot water outlets to the units should be the same dimensions.

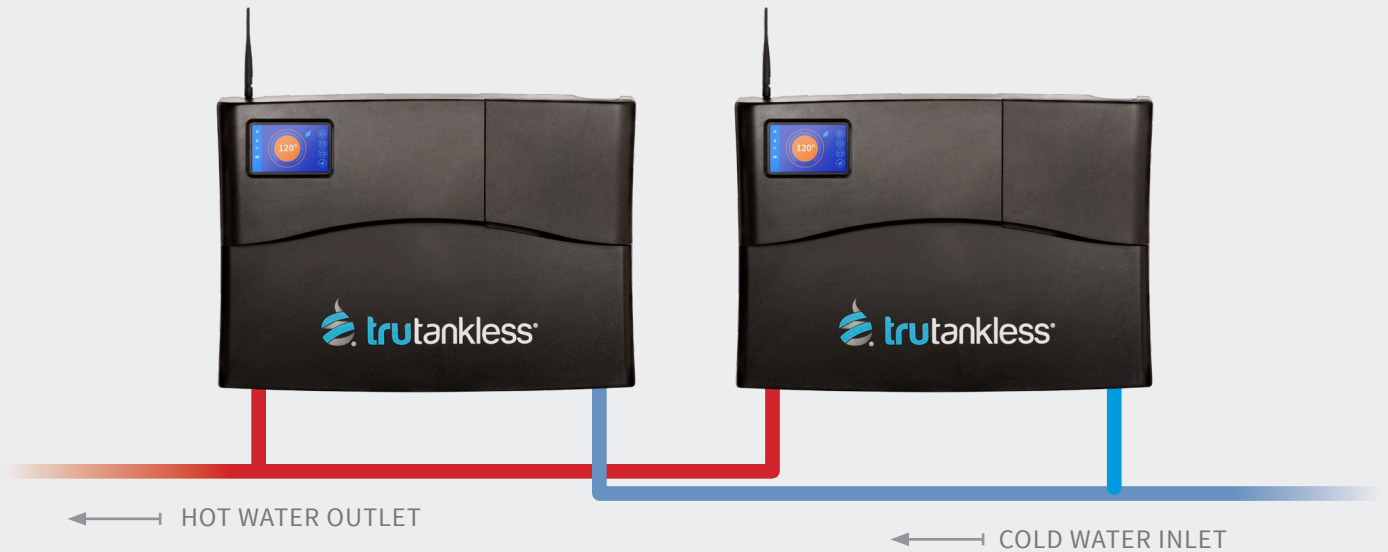

TR SERIES CONFIGURATION

IMPORTANT: The first unit in the series should be set at a lower temperature setting than the second unit. The second unit should be set at the final desired output temperature. Pipe lengths from cold water inlets and hot water outlets to the units should be the same dimensions.

